
CONSTRUCTION AND DIMENSIONAL DIAGRAM



Note:

- 1. Service space (free space needed for servicing) is 200mm on the right, 100mm on the left and 50mm on top.
- 2. The wide and narrow pipes must be thermally insulated.
- 3. Piping length is within 30m
- 4. Height different of the piping between the indoor unit and the outdoor unit should be within 20m.
- 5. Power supply cord length is about 2m
- 6. Connecting cable 2.5mm dia. x 3 (AB Line), 1.6mm dia. x 2 (CD Line) is used for the connection.

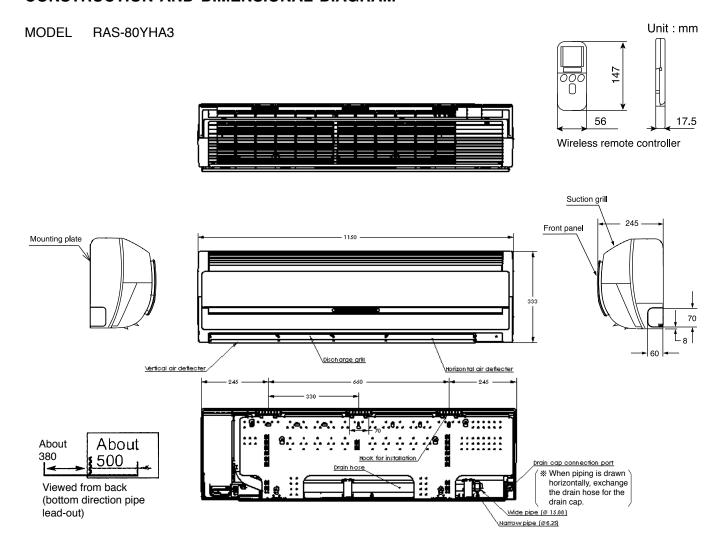