

1.19 iZone 325 - Wiring connection to Hitachi units

Unit Make

Hitachi

Connection

1. Connect a shielded, 2 core, twisted pair control cable from the C225 / C325H to the A / B terminals and earth in the fan coil unit. (This cable is supplied by the installer). Polarity is not see Fig (H) for correct connection.

Indoor Unit

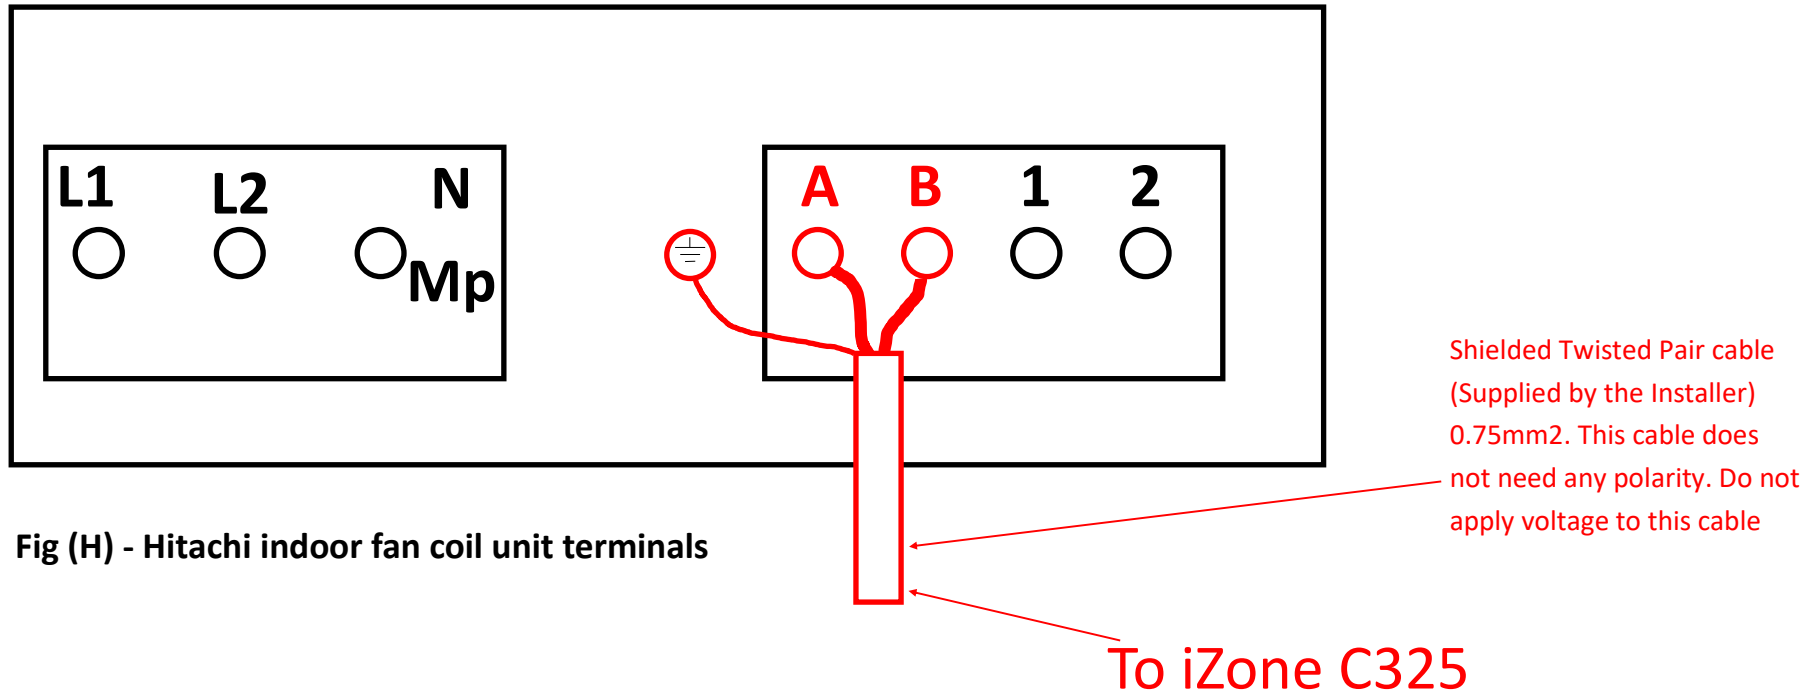


Fig (H) - Hitachi indoor fan coil unit terminals