

<b>Model</b>	<b>OPA 336RKTF-P ECO ULTRA</b>
Configuration	Downward Supply Air
Item No. (Standard / Opposite Hand)	876-034-723 / 876-034-732
Cooling capacity (net) to AS/NZS 3823 T1	28.3 kW
Cooling capacity range (gross)	17.6 ~ 33.6 kW
Heating capacity H1	27.4 kW
Heating capacity range	14.0 ~ 28.9 kW
Electrical input - cooling	8.5 kW
Electrical input - heating	8.3 kW
EER / AEER (cooling)	3.34 / 3.32
COP / ACOP (heating)	3.28 / 3.27
Unit Controller	UC8
Refrigerant	R410A
Refrigerant Charge	9 kg
Compressor oil type	polyvinylether (PVE)
Compressor type	inverter
Power supply	3 ph. 400V ac 50Hz
Compressor (3ph.) run amps at rating cond.	12 / 11 / 11.5 A
Indoor fan motor size	EC plug 500 dia. 2.5 kW
Nominal air flow at rating conditions	1700 l/s
Indoor fan motor (3ph.) - full load	3.3 A/ph.
Outdoor air fan motor (1ph.) - full load	1.7 A (x2)
Outdoor air fan capacitor size	8 $\mu$ fd (x2)
Control circuit breaker (internal)	2 A
Auxiliary power outlet (1ph.) overload setting	10 A
Running amps (total system)	13.5 / 15.5 / 13.0 A
Max. running amps (total system)	19.5 / 21.0 / 18.5 A
Net weight	472 kg

**Accessories:**

Filters - rated EU4/G4 disposable	019-400-008 495x445x50 (x2) 019-400-010 450x600x50 (x2)
-----------------------------------	--

**Optional Controls:**

SAT-3 Room temperature controller	201-000-146
TZT-100 Room temperature controller	201-000-350

Refer to temperzone for other options.

Tested in accordance with AS/NZS 3823



16108

# DIMENSIONS (mm)





Not to Scale

## OPA 336RKTF23-P Standard Hand

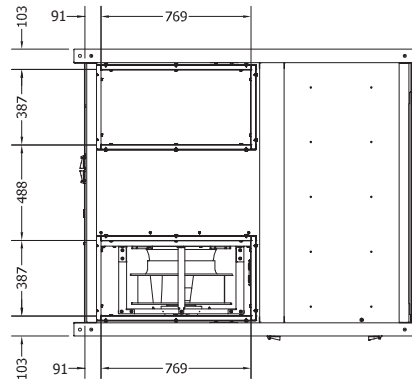
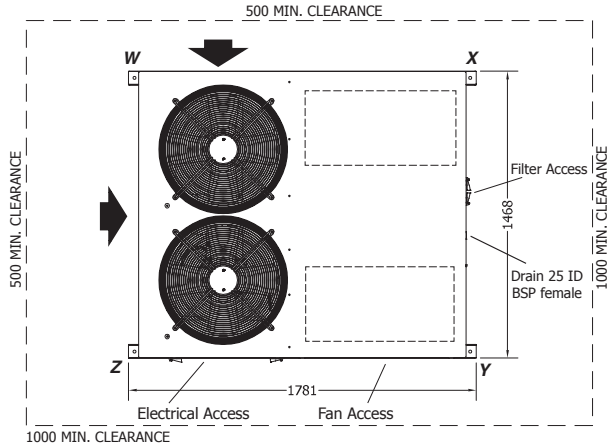


UNDERSIDE VIEW

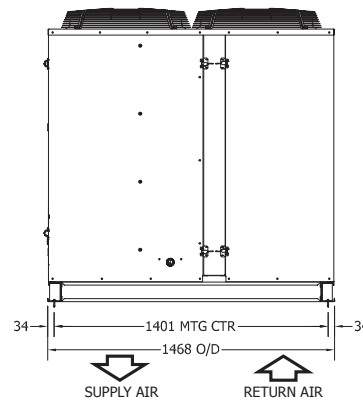
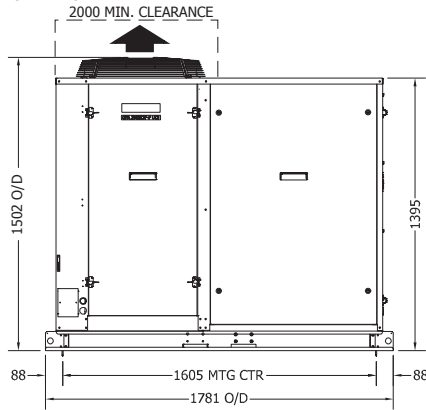


POINT LOADS (kg)			
W	X	Y	Z
75	60	153	191

## OPA 336RKTF32-P Opposite Hand

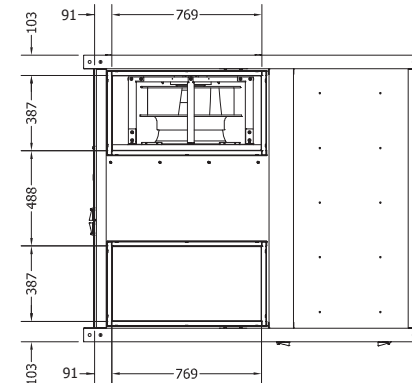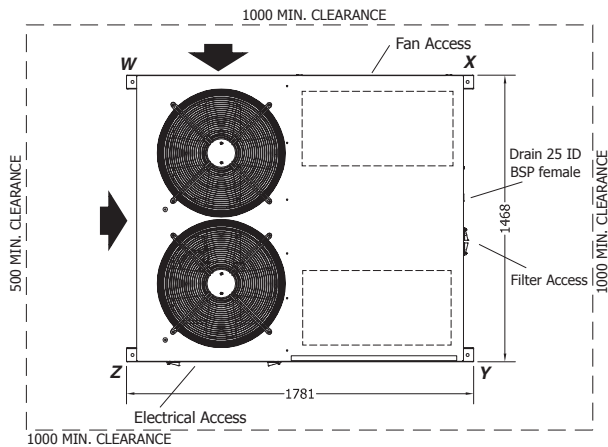


UNDERSIDE VIEW

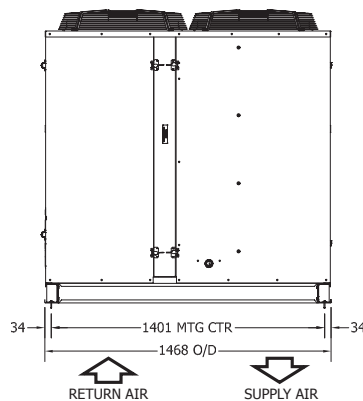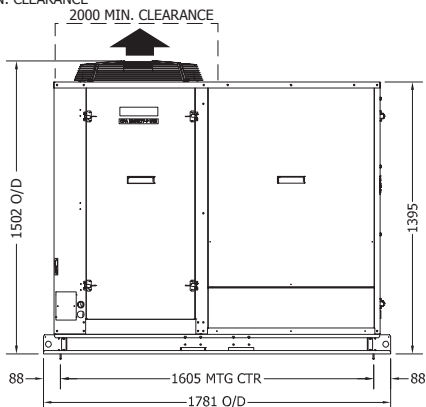

POINT LOADS (kg)			
W	X	Y	Z
75	153	60	191

### NOTE

Specifications are subject to change without notice due to the manufacturer's ongoing research and development programme.

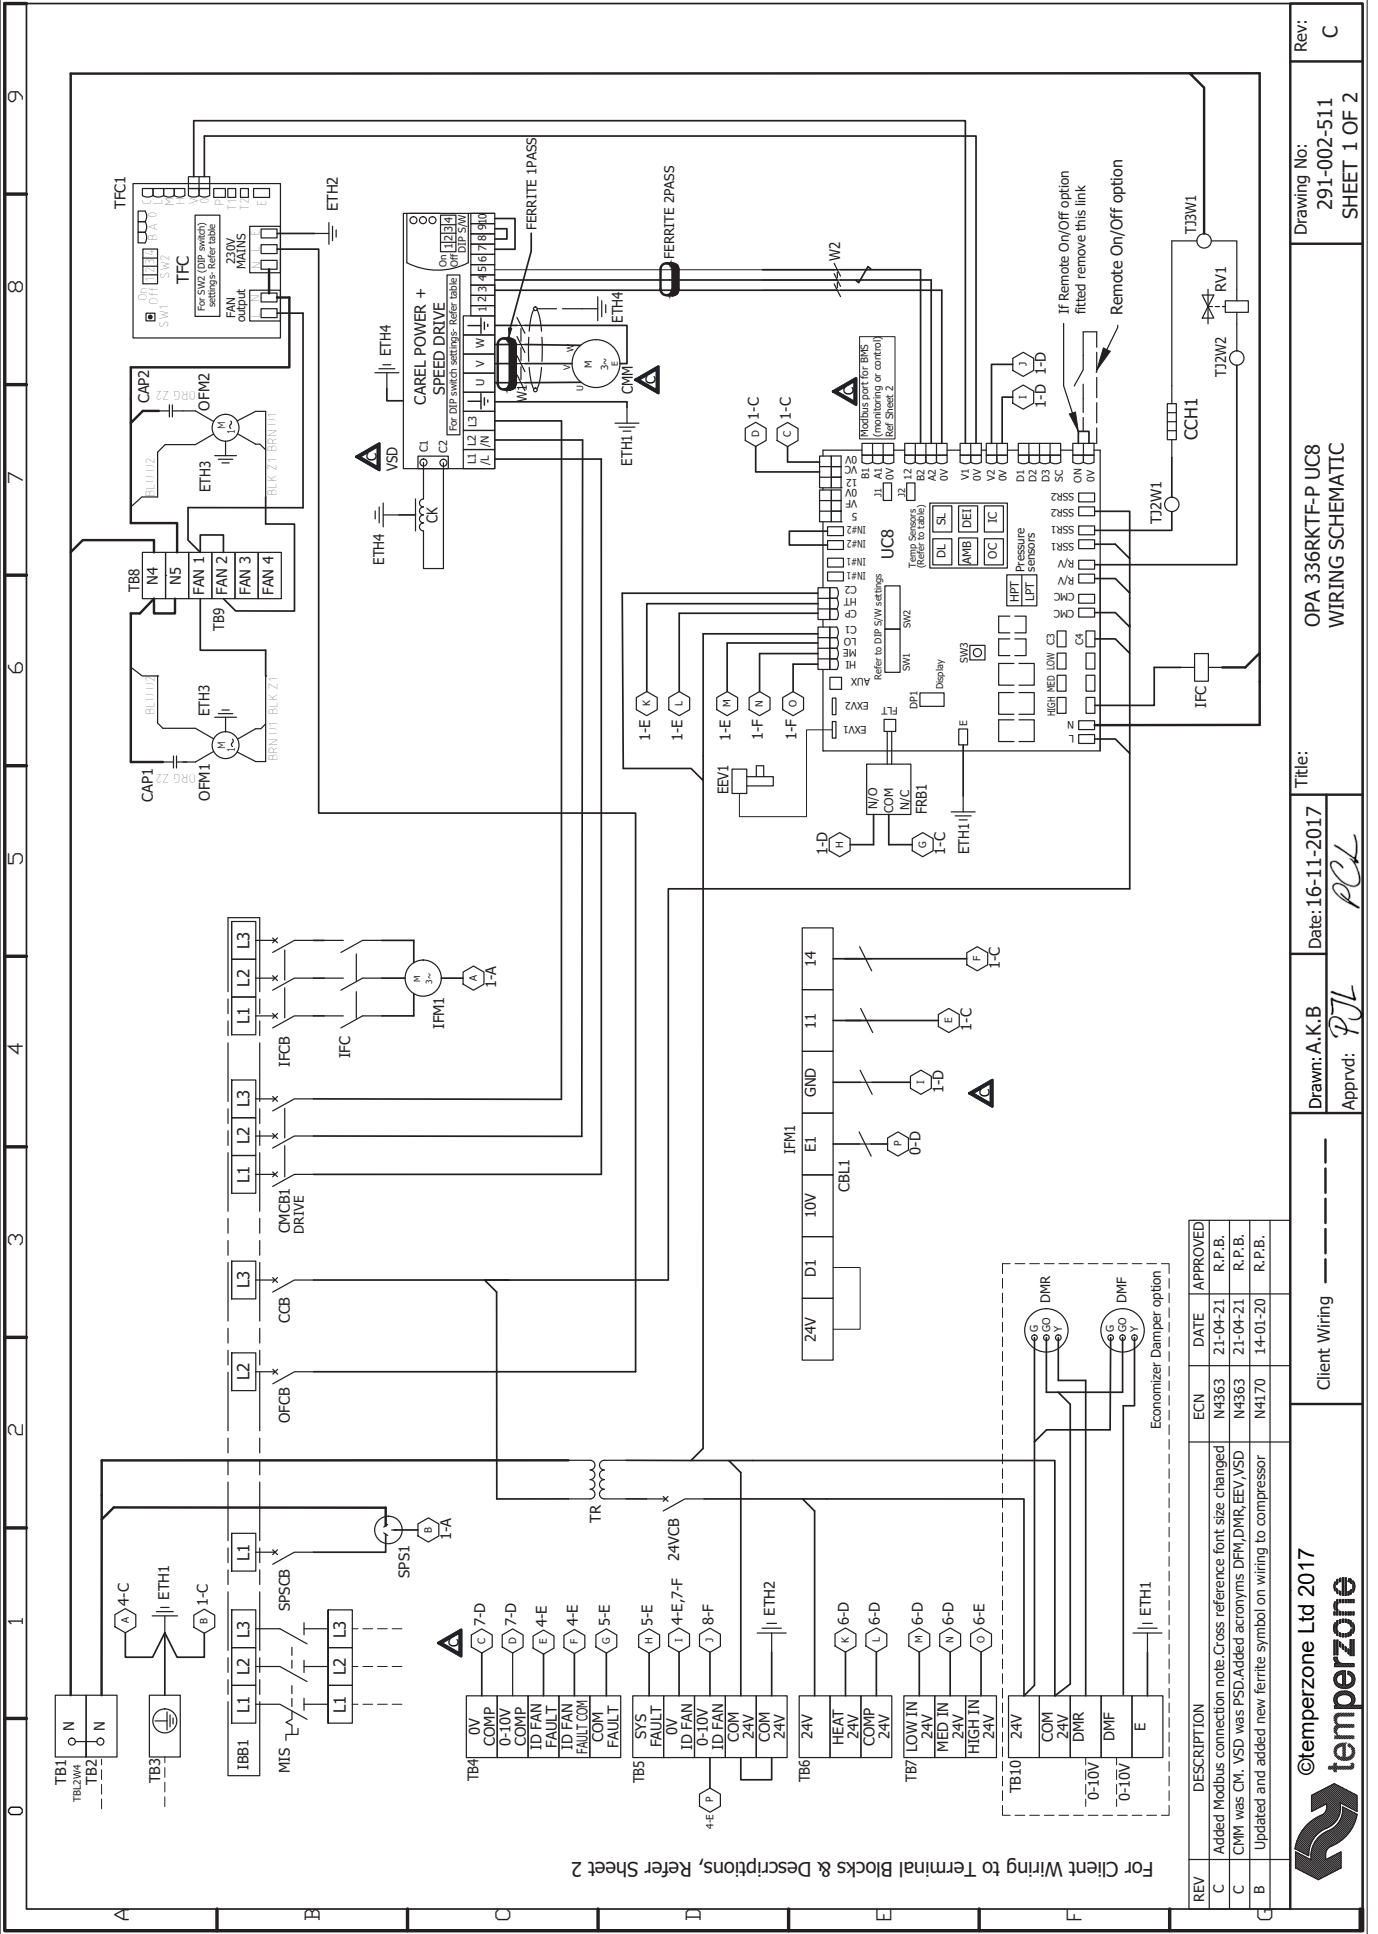

REV	DESCRIPTION	ECN	DATE	APPROVED
C	Added Modbus connection note. Cross reference font size changed	N4363	21-04-21	R.P.B.
C	CMH was CM. VSD was PSD. Added acronyms DPM,DMR,EEV,VSD	N4363	21-04-21	R.P.B.
B	Updated and added new ferrite symbol on wiring to compressor	N4170	14-01-20	R.P.B.



0	1	2	3	4	5	6	7	8	9																																																										
A	<table border="1" style="width:100%; border-collapse: collapse;"> <tr><td>24VCB</td><td>24 VOLT CIRCUIT BREAKER</td></tr> <tr><td>CAP</td><td>CAPACITOR</td></tr> <tr><td>CBL</td><td>CABLE</td></tr> <tr><td>CCB</td><td>CONTROL CIRCUIT BREAKER</td></tr> <tr><td>CCH</td><td>CRANKCASE HEATER</td></tr> <tr><td>CK</td><td>CHOKE</td></tr> <tr><td>CMCB</td><td>COMPRESSOR MOTOR CIRCUIT BREAKER (DRIVE)</td></tr> <tr><td>CMV</td><td>COMPRESSOR MOTOR</td></tr> <tr><td>DMF</td><td>DAMPER MOTOR FRESH AIR</td></tr> <tr><td>DMR</td><td>DAMPER MOTOR RETURN AIR</td></tr> <tr><td>EEV</td><td>ELECTRONIC EXPANSION VALVE</td></tr> <tr><td>ETH</td><td>EARTH</td></tr> <tr><td>FRB</td><td>FAULT RELAY BOARD</td></tr> <tr><td>IFC</td><td>INDOOR FAN CONTACTOR</td></tr> <tr><td>IFCB</td><td>INDOOR FAN CIRCUIT BREAKER</td></tr> <tr><td>IFM</td><td>INDOOR FAN MOTOR</td></tr> <tr><td>IBB</td><td>INSULATED BUS BAR</td></tr> <tr><td>MIS</td><td>MAIN ISOLATOR SWITCH</td></tr> <tr><td>OFCB</td><td>OUTDOOR FAN CIRCUIT BREAKER</td></tr> <tr><td>OFM</td><td>OUTDOOR FAN MOTOR</td></tr> <tr><td>RV</td><td>REVERSING VALVE</td></tr> <tr><td>SPSCB</td><td>SINGLE PHASE SOCKET CIRCUIT BREAKER</td></tr> <tr><td>SPS</td><td>SINGLE PHASE SOCKET</td></tr> <tr><td>TB</td><td>TERMINAL BLOCK</td></tr> <tr><td>TFC</td><td>TRIAC FAN CONTROLLER</td></tr> <tr><td>TJ</td><td>TERMINAL JOINER</td></tr> <tr><td>TR</td><td>TRANSFORMER</td></tr> <tr><td>UC8</td><td>UNIT CONTROLLER 8</td></tr> <tr><td>VSD</td><td>VARIABLE SPEED DRIVE</td></tr> </table>		24VCB	24 VOLT CIRCUIT BREAKER	CAP	CAPACITOR	CBL	CABLE	CCB	CONTROL CIRCUIT BREAKER	CCH	CRANKCASE HEATER	CK	CHOKE	CMCB	COMPRESSOR MOTOR CIRCUIT BREAKER (DRIVE)	CMV	COMPRESSOR MOTOR	DMF	DAMPER MOTOR FRESH AIR	DMR	DAMPER MOTOR RETURN AIR	EEV	ELECTRONIC EXPANSION VALVE	ETH	EARTH	FRB	FAULT RELAY BOARD	IFC	INDOOR FAN CONTACTOR	IFCB	INDOOR FAN CIRCUIT BREAKER	IFM	INDOOR FAN MOTOR	IBB	INSULATED BUS BAR	MIS	MAIN ISOLATOR SWITCH	OFCB	OUTDOOR FAN CIRCUIT BREAKER	OFM	OUTDOOR FAN MOTOR	RV	REVERSING VALVE	SPSCB	SINGLE PHASE SOCKET CIRCUIT BREAKER	SPS	SINGLE PHASE SOCKET	TB	TERMINAL BLOCK	TFC	TRIAC FAN CONTROLLER	TJ	TERMINAL JOINER	TR	TRANSFORMER	UC8	UNIT CONTROLLER 8	VSD	VARIABLE SPEED DRIVE	B	C	D	E	F	G	H
24VCB	24 VOLT CIRCUIT BREAKER																																																																		
CAP	CAPACITOR																																																																		
CBL	CABLE																																																																		
CCB	CONTROL CIRCUIT BREAKER																																																																		
CCH	CRANKCASE HEATER																																																																		
CK	CHOKE																																																																		
CMCB	COMPRESSOR MOTOR CIRCUIT BREAKER (DRIVE)																																																																		
CMV	COMPRESSOR MOTOR																																																																		
DMF	DAMPER MOTOR FRESH AIR																																																																		
DMR	DAMPER MOTOR RETURN AIR																																																																		
EEV	ELECTRONIC EXPANSION VALVE																																																																		
ETH	EARTH																																																																		
FRB	FAULT RELAY BOARD																																																																		
IFC	INDOOR FAN CONTACTOR																																																																		
IFCB	INDOOR FAN CIRCUIT BREAKER																																																																		
IFM	INDOOR FAN MOTOR																																																																		
IBB	INSULATED BUS BAR																																																																		
MIS	MAIN ISOLATOR SWITCH																																																																		
OFCB	OUTDOOR FAN CIRCUIT BREAKER																																																																		
OFM	OUTDOOR FAN MOTOR																																																																		
RV	REVERSING VALVE																																																																		
SPSCB	SINGLE PHASE SOCKET CIRCUIT BREAKER																																																																		
SPS	SINGLE PHASE SOCKET																																																																		
TB	TERMINAL BLOCK																																																																		
TFC	TRIAC FAN CONTROLLER																																																																		
TJ	TERMINAL JOINER																																																																		
TR	TRANSFORMER																																																																		
UC8	UNIT CONTROLLER 8																																																																		
VSD	VARIABLE SPEED DRIVE																																																																		
<div style="display: flex; justify-content: space-between;"> <div style="width: 45%;"> <p><b>Important Notes:</b></p> <ol style="list-style-type: none"> <li>Crankcase Heater Note 24 Hour power required for control circuit and crankcase heaters</li> </ol> </div> <div style="width: 50%;"> <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">Sensors (S) / Transducers (T)</th> </tr> <tr> <th>Name</th> <th>Type</th> </tr> <tr> <td>DL</td> <td>Discharge Temp</td> </tr> <tr> <td>SL</td> <td>Suction Temp</td> </tr> <tr> <td>AMB</td> <td>Ambient Temp</td> </tr> <tr> <td>DEI</td> <td>De-ice Temp</td> </tr> <tr> <td>LPT</td> <td>Suction Pressure</td> </tr> <tr> <td>HPT</td> <td>High Pressure</td> </tr> </table>   <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">SAT-3 &amp; TZT100 connection to UC8 terminals</th> </tr> <tr> <th>UC8 terminals</th> <th>SAT-3</th> </tr> <tr> <td>12</td> <td>12V</td> </tr> <tr> <td>B2</td> <td>B</td> </tr> <tr> <td>A2</td> <td>A</td> </tr> <tr> <td>0V</td> <td>GND</td> </tr> <tr> <td>Screen to 0V</td> <td>24C</td> </tr> </table>   <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">UC8 DIP switch settings</th> </tr> <tr> <th>DIP switch</th> <th>On/Off</th> </tr> <tr> <td>1,4,6,7,10</td> <td>On</td> </tr> <tr> <td>All Others Off</td> <td>Off</td> </tr> </table>   <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">PSD DIP switch settings</th> </tr> <tr> <th>DIP switch</th> <th>On/Off</th> </tr> <tr> <td>1, 4</td> <td>On</td> </tr> <tr> <td>2, 3</td> <td>Off</td> </tr> </table>   <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">TFC DIP switch settings</th> </tr> <tr> <th>DIP switch</th> <th>On/Off</th> </tr> <tr> <td>1, 2, 3, 4</td> <td>On</td> </tr> <tr> <td>Others</td> <td>Off</td> </tr> </table> </div> </div>										Sensors (S) / Transducers (T)		Name	Type	DL	Discharge Temp	SL	Suction Temp	AMB	Ambient Temp	DEI	De-ice Temp	LPT	Suction Pressure	HPT	High Pressure	SAT-3 & TZT100 connection to UC8 terminals		UC8 terminals	SAT-3	12	12V	B2	B	A2	A	0V	GND	Screen to 0V	24C	UC8 DIP switch settings		DIP switch	On/Off	1,4,6,7,10	On	All Others Off	Off	PSD DIP switch settings		DIP switch	On/Off	1, 4	On	2, 3	Off	TFC DIP switch settings		DIP switch	On/Off	1, 2, 3, 4	On	Others	Off				
Sensors (S) / Transducers (T)																																																																			
Name	Type																																																																		
DL	Discharge Temp																																																																		
SL	Suction Temp																																																																		
AMB	Ambient Temp																																																																		
DEI	De-ice Temp																																																																		
LPT	Suction Pressure																																																																		
HPT	High Pressure																																																																		
SAT-3 & TZT100 connection to UC8 terminals																																																																			
UC8 terminals	SAT-3																																																																		
12	12V																																																																		
B2	B																																																																		
A2	A																																																																		
0V	GND																																																																		
Screen to 0V	24C																																																																		
UC8 DIP switch settings																																																																			
DIP switch	On/Off																																																																		
1,4,6,7,10	On																																																																		
All Others Off	Off																																																																		
PSD DIP switch settings																																																																			
DIP switch	On/Off																																																																		
1, 4	On																																																																		
2, 3	Off																																																																		
TFC DIP switch settings																																																																			
DIP switch	On/Off																																																																		
1, 2, 3, 4	On																																																																		
Others	Off																																																																		
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>REV</th> <th>DESCRIPTION</th> <th>ECN</th> <th>DATE</th> <th>APPROVED</th> </tr> <tr> <td>C</td> <td>Added Modbus connection note. Cross reference font size changed</td> <td>N4363</td> <td>21-04-21</td> <td>R.P.B.</td> </tr> <tr> <td>C</td> <td>OMM was CM. VSD was PSD. Added acronyms DFM, DMR, EEV, VSD</td> <td>N4363</td> <td>21-04-21</td> <td>R.P.B.</td> </tr> <tr> <td>B</td> <td>Updated and added new ferrite symbol on wiring to compressor</td> <td>N4170</td> <td>31-12-19</td> <td>R.P.B.</td> </tr> </table>										REV	DESCRIPTION	ECN	DATE	APPROVED	C	Added Modbus connection note. Cross reference font size changed	N4363	21-04-21	R.P.B.	C	OMM was CM. VSD was PSD. Added acronyms DFM, DMR, EEV, VSD	N4363	21-04-21	R.P.B.	B	Updated and added new ferrite symbol on wiring to compressor	N4170	31-12-19	R.P.B.																																						
REV	DESCRIPTION	ECN	DATE	APPROVED																																																															
C	Added Modbus connection note. Cross reference font size changed	N4363	21-04-21	R.P.B.																																																															
C	OMM was CM. VSD was PSD. Added acronyms DFM, DMR, EEV, VSD	N4363	21-04-21	R.P.B.																																																															
B	Updated and added new ferrite symbol on wiring to compressor	N4170	31-12-19	R.P.B.																																																															
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width: 30%;"></td> <td style="width: 30%; text-align: center;">Client Wiring</td> <td style="width: 20%; text-align: center;">Date: 16-11-2017</td> <td style="width: 20%; text-align: center;">Title: OPA 336RKTf-P UC8 Wiring Schematic</td> </tr> <tr> <td style="text-align: center;">Drawn: A.K.B</td> <td style="text-align: center;">P.J.L</td> <td style="text-align: center;">Date: 16-11-2017</td> <td style="text-align: center;">Title: OPA 336RKTf-P UC8 Wiring Schematic</td> </tr> <tr> <td style="text-align: center;">Approvd: P.J.L</td> <td style="text-align: center;">P.J.L</td> <td style="text-align: center;">Date: 16-11-2017</td> <td style="text-align: center;">Title: OPA 336RKTf-P UC8 Wiring Schematic</td> </tr> </table>											Client Wiring	Date: 16-11-2017	Title: OPA 336RKTf-P UC8 Wiring Schematic	Drawn: A.K.B	P.J.L	Date: 16-11-2017	Title: OPA 336RKTf-P UC8 Wiring Schematic	Approvd: P.J.L	P.J.L	Date: 16-11-2017	Title: OPA 336RKTf-P UC8 Wiring Schematic																																														
	Client Wiring	Date: 16-11-2017	Title: OPA 336RKTf-P UC8 Wiring Schematic																																																																
Drawn: A.K.B	P.J.L	Date: 16-11-2017	Title: OPA 336RKTf-P UC8 Wiring Schematic																																																																
Approvd: P.J.L	P.J.L	Date: 16-11-2017	Title: OPA 336RKTf-P UC8 Wiring Schematic																																																																
<div style="display: flex; justify-content: space-between;"> <div style="width: 45%;"> <p><b>Client Wiring</b></p> <p>Client External Protection and Isolator switch</p> <p>Remote option</p> <p>If Remote On/Off option fitted remove this link</p> <p>Remote On/Off option</p> </div> <div style="width: 50%;"> <p><b>BMS Control</b></p> </div> </div>																																																																			

